

**PROFORMA REGARDING SAFE DRINKING WATER AND SANITARY CONDITION
CERTIFICATE.**

No. _____

Date: 18/10/2021

It is certified that an inspection team headed by MR. SUHAS
KANEKAR (PROPRIETOR) (Name of Officers
with designation) from HYDROTECH LABORATORY PUNE (Name of
Department/Office) inspected the DHANIRAJ ENGLISH MEDIUM
SCHOOL DATTAWADI (Name & Address of
the School) on 18/10/2021 and found that the DHANIRAJ ENGLISH
MEDIUM SCHOOL DATTAWADI (Name of school) has safe
drinking water facilities for the students and members of staff of the institution and is maintaining
the hygienic sanitation condition in the school building & the campus as per the norms
prescribed by the Central/State/U.T. Govt.

The above valid for a period of 1 YEAR



Signature with Seal: _____

Name : MR. SUHAS KANEKAR

Designation : PROPRIETOR


To

DHANIRAJ ENGLISH
MEDIUM SCHOOL
DATTAWADI

(Name & Address of the Institution)

HYDROTECH LABORATORY
Office No.01, Malika Sun Heights,
Left Bhusari Colony, Opp. 1 Dapo,
Near Chandani Chauk, Pune - 411 033
Contact No. 9970213515 / 8. 6823476
Email id : hydrotechlaboratory@gmail.com
hydrotechlab@rediffmail.com

86

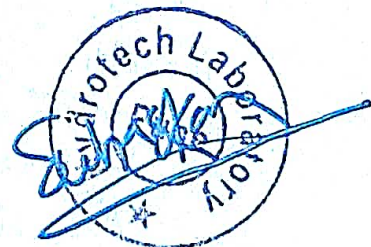

HYDROTECH LABORATORY
Office No.01, Malika Sun Heights,
Left Bhusari Colony, Opp. 1 Dapo,
Near Chandani Chauk, Pune - 411 033
Contact No. 9970213515 / 8. 6823476
Email id : hydrotechlaboratory@gmail.com
hydrotechlab@rediffmail.com

HYDROTECH LABORATORY

Email : hydrotechlab@rediffmail.com, / hydrotechlaboratory@gmail.com Mobile : 9970213615 / 8806923476

DATE OF ISSUE: 18.10.2021

REPORT NUMBER : HTL/21-22/741

CUSTOMER NAME : DHANIRAJ ENGLISH MEDIUM SCHOOL
DATTAWADI

SAMPLE IDENTIFICATION : DRINKING WATER

SAMPLE DETAILS

RECEIPT DATE	12.10.2021	TYPE	WATER
NO.	01	COLLECTED BY	HYDROTECH LABORATORY

DRINKING WATER ANALYSIS REPORT

SR. NO	PARAMETERS	VALUE	IS 10500:2012 LIMITS	METHOD OF ANALYSIS
1.	pH	7.65	6.5-8.5	IS 3025 (part 11) :1983
2.	Turbidity(NTU)	Nil	1(Max.)	IS 3025 (part 10) :1984
3.	Total Alkalinity as CaCO ₃ (mg/Litre)	115.00	200(Max.)	IS 3025 (part 23) :1983
4.	Total Hardness as CaCO ₃ (mg/Litre)	145.00	200(Max.)	IS 3025 (part 21) :1983
5.	Chlorides as Cl (mg/Litre)	10.63	250(Max.)	IS 3025 (part 32) :1988
6.	Total Dissolved Solids(mg/Litre)	275.00	500(Max.)	IS 3025 (part 16) :1984
7.	Iron as Fe(mg/Litre)	0.020	0.3(Max.)	IS 3025 (part 53) :2003
8.	Sulphates as SO ₄ (mg/Litre)	0.80	200(Max.)	IS 3025 (part 24) :1986
9.	Nitrates as NO ₃ (mg/Litre)	0.32	45(Max.)	IS 3025 (part 34) :1988
10.	Fluoride as F(mg/Litre)	Nil	1(Max.)	IS 3025 (part 60) :2008
11.	Calcium as Ca(mg/Litre)	40.00	75(Max.)	IS 3025 (part 40) :1991
12.	Magnesium as Mg(mg/Litre)	10.93	30(Max.)	IS 3025 (part 46) :1994
13.	Coliform MPN(No. per 100 ml)	Nil	Nil	IS 1622:1981
14.	E.Coli (per 100 ml)	Absent	Absent	IS1622:1981

Please note that IS refers to Indian Standard, a specification published by Bureau of Indian Standards.

Note: Chemical and Microbial analysis reveals that above water sample is POTABLE.
(SUITABLE FOR DRINKING)

Subhaskar
FOR HYDROTECH LABORATORY

Note: This analysis report is extended as technical assistance only & Hydrotech Laboratory will not be involved in any legal dispute arising out of this report.

HYDROTECH LABORATORY

Office No.01, Mallikarjuna Heights,
Left Bhusari Colony, W. P. O.,
Near Chandani Chau. P. O. 438
Contact No.9970213615 / 8806923476
Email id : hydrotechlaboratory@gmail.com
hydrotechlab@rediffmail.com

